
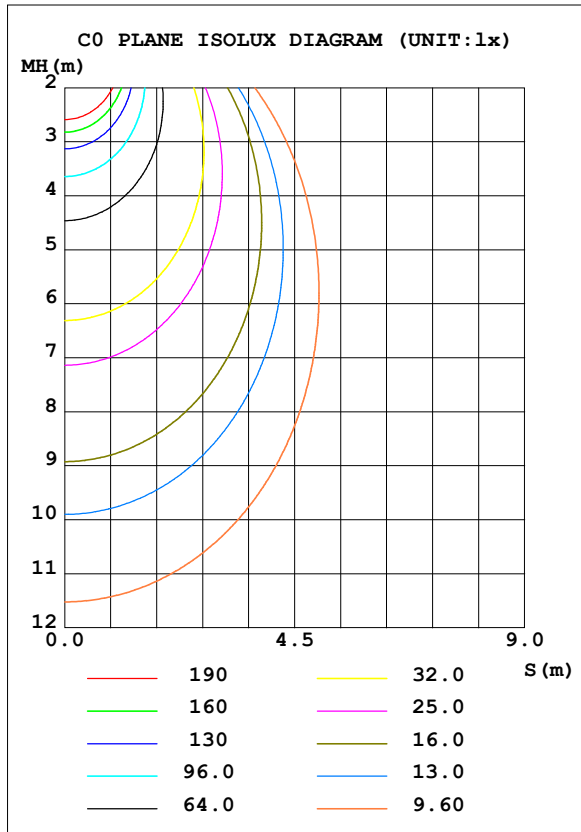


Date:	_____
Project:	_____
Price:	_____

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 100.71 lm/W			
MODEL	Chelsea	I _{max} (cd)	1268	S/MH (C0/180)	1.12
NOMINAL POWER (W)	30.85	LOR (%)	100.0	S/MH (C90/270)	1.18
RATED VOLTAGE (V)	220	TOTAL FLUX (lm)	3059.0	η UP, DN (C0-180)	0.6, 49.6
NOMINAL FLUX (lm)	3058.97	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.6, 49.2
LAMPS INSIDE	1	η up (%)	1.2	CIBSE SHR NOM	1.25
TEST VOLTAGE (V)	220	η down (%)	98.8	CIBSE SHR MAX	1.30

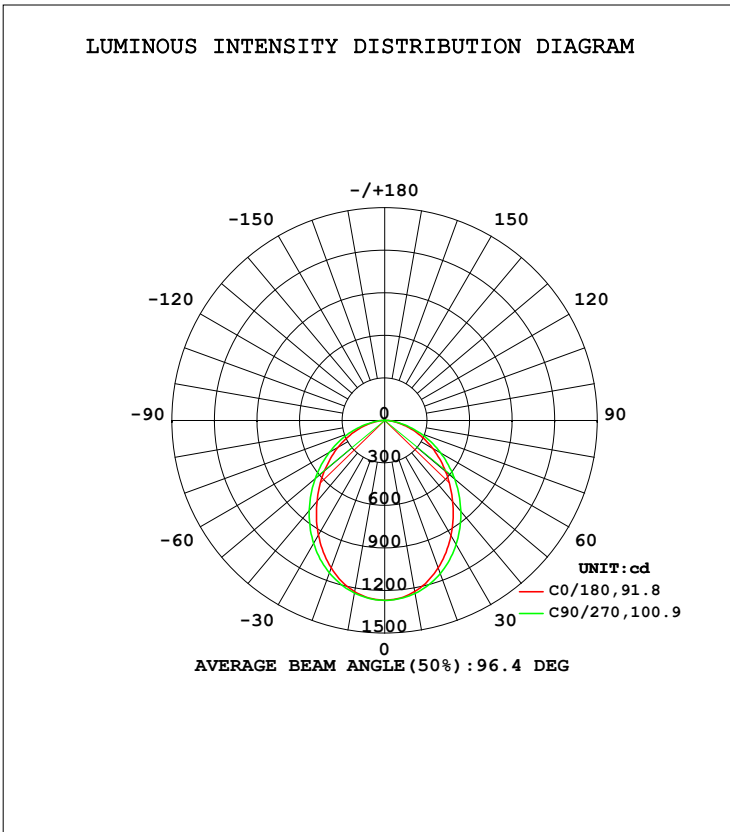

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1225	1232	1238	1232	1226	1229	1235	1230	0- 10	119.2	119.2	3.9,3.9
20	1106	1129	1149	1127	1106	1123	1143	1125	10- 20	333.9	453.1	14.8,14.8
30	936.1	973.7	1009	970.8	934.8	964.5	1002	969.4	20- 30	484.4	937.5	30.6,30.6
40	747.1	790.1	835.7	786.2	743.8	780.1	829.1	786.8	30- 40	550.5	1488	48.6,48.6
50	561.8	601.1	645.6	595.6	556.7	591.1	640.4	598.9	40- 50	534.6	2023	66.1,66.1
60	388.8	419.4	454.5	412.6	381.4	409.6	451.1	418.2	50- 60	453.5	2476	80.9,80.9
70	228.4	248.1	270.2	240.4	220.5	239.3	269.2	248.4	60- 70	326.6	2803	91.6,91.6
80	88.03	95.87	103.6	88.98	80.79	88.70	104.3	96.43	70- 80	175.8	2978	97.4,97.4
90	3.019	3.129	3.216	2.990	2.591	2.753	3.078	2.941	80- 90	43.22	3022	98.8,98.8
100	3.469	3.582	3.952	3.716	3.162	3.423	3.678	3.292	90-100	3.448	3025	98.9,98.9
110	4.404	4.513	4.967	4.681	3.949	4.295	4.656	4.130	100-110	4.196	3029	99,99
120	5.528	5.596	6.087	5.799	4.914	5.286	5.679	5.083	110-120	4.905	3034	99.2,99.2
130	6.837	6.814	7.281	7.048	6.054	6.403	6.754	6.157	120-130	5.417	3040	99.4,99.4
140	8.144	8.058	8.427	8.260	7.330	7.599	7.874	7.358	130-140	5.604	3045	99.5,99.5
150	9.343	9.194	9.454	9.352	8.666	8.817	9.016	8.588	140-150	5.300	3050	99.7,99.7
160	10.50	10.25	10.44	10.42	9.991	10.00	10.11	9.759	150-160	4.435	3055	99.9,99.9
170	11.52	11.13	11.19	11.22	11.27	11.01	11.01	10.84	160-170	3.013	3058	100,100
180	11.99	11.59	11.52	11.55	12.02	11.62	11.53	11.55	170-180	1.084	3059	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:KEVINLI
 Test Date:2017-12-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

LUMINANCE LIMITATION CURVES

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

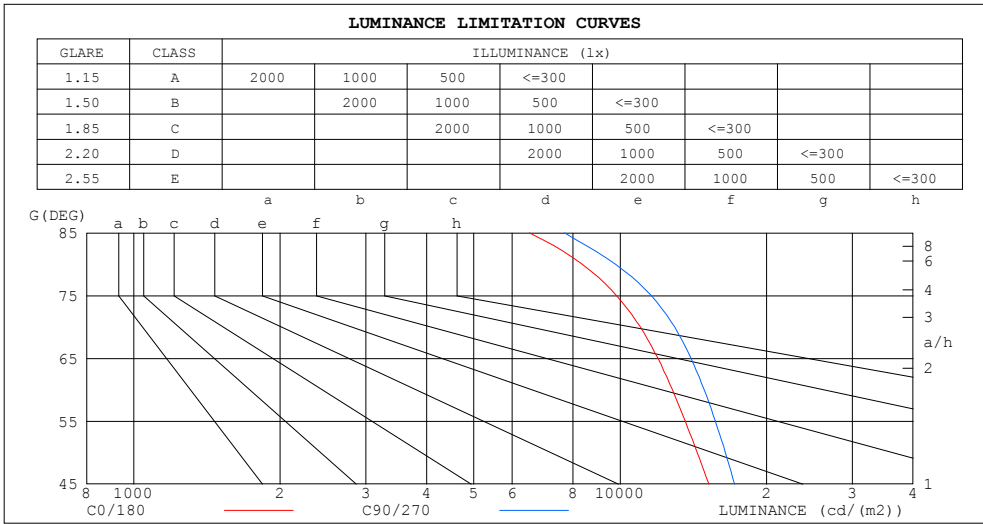

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	6509	7690
80	8352	9775
75	9833	11592
70	11002	12939
65	11963	13990
60	12810	14887
55	13608	15696
50	14399	16451
45	15224	17185

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:




Date:	_____
Project:	_____
Price:	_____

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

ρcc	80%			70%			50%			30%			10%			0			
	ρw	50%	30%	10%	ρw	50%	30%	10%	ρw	50%	30%	10%	ρw	50%	30%	10%	ρw	50%	30%
ρfc	20%			20%			20%			20%			20%			0			
RCR	RCR:Room Cavity Ratio																		
	Coefficients of Utilization (CU)																		
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.10	1.10	1.10	1.05	1.05	1.05	1.01	1.01	1.01	.99			
1.0	1.05	1.00	.97	1.02	.98	.95	.98	.95	.92	.94	.91	.89	.90	.88	.86	.84			
2.0	.92	.85	.80	.90	.84	.79	.86	.81	.77	.83	.78	.75	.79	.76	.73	.71			
3.0	.81	.73	.67	.79	.72	.66	.76	.70	.65	.73	.68	.64	.71	.66	.63	.60			
4.0	.72	.64	.57	.71	.63	.57	.68	.61	.56	.66	.60	.55	.63	.58	.54	.52			
5.0	.65	.56	.50	.64	.55	.49	.61	.54	.49	.59	.53	.48	.57	.52	.47	.45			
6.0	.59	.50	.44	.58	.49	.43	.56	.48	.43	.54	.47	.43	.52	.47	.42	.40			
7.0	.53	.45	.39	.52	.44	.39	.51	.44	.38	.49	.43	.38	.48	.42	.38	.36			
8.0	.49	.41	.35	.48	.40	.35	.47	.39	.34	.45	.39	.34	.44	.38	.34	.32			
9.0	.45	.37	.31	.44	.37	.31	.43	.36	.31	.42	.35	.31	.41	.35	.31	.29			
10.0	.42	.34	.29	.41	.34	.29	.40	.33	.28	.39	.33	.28	.38	.32	.28	.26			

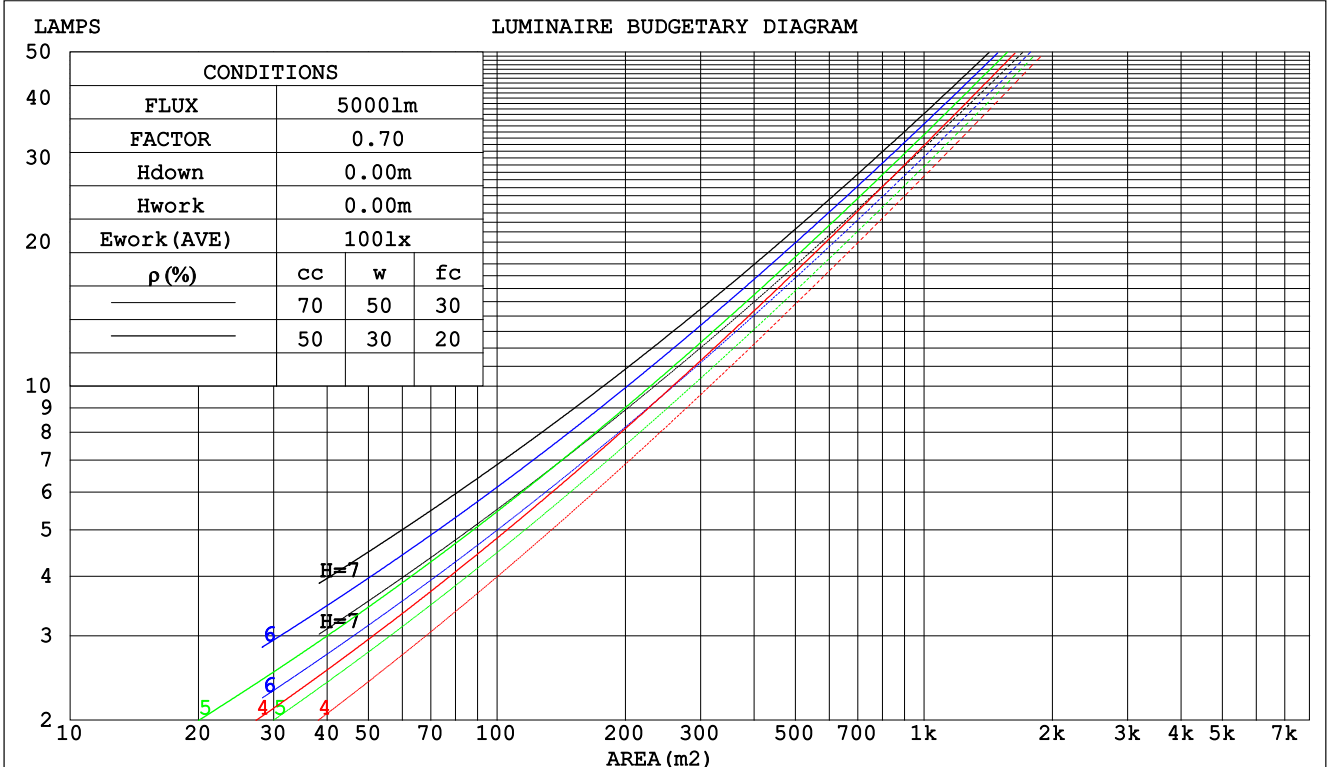

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

WEC AND CCEC

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.291	.166	.052	.284	.162	.051	.270	.155	.049	.257	.148	.048	.246	.142	.046	
2.0	.276	.151	.046	.270	.149	.046	.257	.143	.044	.246	.138	.043	.236	.133	.042	
3.0	.257	.137	.041	.251	.135	.041	.241	.130	.040	.231	.126	.039	.221	.123	.038	
4.0	.238	.124	.036	.233	.122	.036	.224	.119	.035	.215	.115	.035	.207	.112	.034	
5.0	.221	.113	.033	.217	.111	.032	.208	.108	.032	.200	.106	.031	.193	.103	.031	
6.0	.206	.103	.030	.202	.102	.029	.194	.100	.029	.187	.097	.029	.180	.095	.028	
7.0	.192	.095	.027	.189	.094	.027	.182	.092	.026	.175	.090	.026	.169	.088	.026	
8.0	.180	.088	.025	.177	.087	.025	.171	.085	.024	.165	.083	.024	.159	.082	.024	
9.0	.169	.082	.023	.166	.081	.023	.161	.079	.022	.155	.078	.022	.150	.076	.022	
10.0	.159	.076	.021	.157	.076	.021	.152	.074	.021	.147	.073	.021	.142	.072	.021	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.200	.200	.200	.171	.171	.171	.117	.117	.117	.067	.067	.067	.021	.021	.021	
1.0	.188	.166	.145	.161	.142	.125	.110	.098	.086	.063	.057	.050	.020	.018	.016	
2.0	.180	.141	.109	.154	.122	.095	.105	.084	.066	.061	.049	.039	.020	.016	.013	
3.0	.171	.124	.086	.147	.107	.074	.101	.074	.052	.058	.043	.031	.019	.014	.010	
4.0	.164	.110	.069	.140	.095	.060	.097	.066	.043	.056	.039	.025	.018	.013	.008	
5.0	.156	.100	.058	.134	.086	.051	.092	.060	.036	.054	.035	.021	.017	.012	.007	
6.0	.149	.091	.050	.128	.079	.043	.088	.055	.031	.051	.033	.018	.017	.011	.006	
7.0	.143	.084	.044	.123	.073	.038	.085	.051	.027	.049	.030	.016	.016	.010	.005	
8.0	.136	.079	.039	.117	.068	.034	.081	.048	.024	.047	.028	.014	.015	.009	.005	
9.0	.130	.074	.035	.112	.064	.031	.078	.045	.022	.045	.027	.013	.015	.009	.004	
10.0	.125	.069	.033	.108	.060	.028	.075	.042	.020	.044	.025	.012	.014	.008	.004	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

UGR(Unified Glare Rating) Table

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm										
NAME: ILLCLBV					TYPE: ILLCLBV					WEIGHT:
SPEC.: 4FT					DIM.: 4FT					SERIAL No.:1
MFR.: i-Luminosity					SUR.:1220*50					Shielding Angle:
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	17.7	19.2	18.0	19.4	19.6	18.4	19.8	18.7	20.1	20.3
3H	19.0	20.3	19.3	20.6	20.8	19.8	21.1	20.1	21.4	21.6
4H	19.5	20.7	19.8	21.0	21.3	20.3	21.6	20.6	21.8	22.1
6H	19.8	21.0	20.1	21.3	21.6	20.6	21.8	21.0	22.1	22.4
8H	19.9	21.0	20.2	21.3	21.6	20.7	21.9	21.1	22.2	22.5
12H	19.9	21.0	20.3	21.3	21.7	20.8	21.9	21.1	22.2	22.5
4H 2H	18.3	19.6	18.7	19.9	20.1	18.9	20.1	19.2	20.4	20.7
3H	19.8	20.9	20.2	21.2	21.5	20.4	21.5	20.8	21.9	22.2
4H	20.4	21.4	20.8	21.7	22.1	21.1	22.1	21.5	22.4	22.8
6H	20.8	21.7	21.2	22.1	22.5	21.5	22.4	22.0	22.8	23.2
8H	20.9	21.8	21.4	22.2	22.6	21.7	22.5	22.1	22.9	23.3
12H	21.0	21.8	21.5	22.2	22.6	21.8	22.5	22.2	22.9	23.4
8H 4H	20.6	21.5	21.1	21.9	22.3	21.3	22.1	21.7	22.5	22.9
6H	21.2	21.9	21.7	22.3	22.8	21.9	22.5	22.3	23.0	23.4
8H	21.4	22.0	21.9	22.4	22.9	22.1	22.7	22.5	23.1	23.6
12H	21.5	22.0	22.0	22.5	23.0	22.2	22.7	22.7	23.2	23.7
12H 4H	20.6	21.4	21.1	21.8	22.2	21.3	22.0	21.7	22.4	22.9
6H	21.2	21.8	21.7	22.3	22.8	21.9	22.5	22.4	22.9	23.4
8H	21.5	22.0	22.0	22.5	23.0	22.1	22.7	22.6	23.1	23.6
Variations with the observer position at spacings:										
S = 1.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.2				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.2 / - 0.4					+ 0.3 / - 0.3				

CIE Pub.117, 3059 lm Total Lamp Luminous Flux Correct (8log(F/F0) = 3.9)

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:KEVINLI
 Test Date:2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

UTILIZATION FACTORS TABLE

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	60	49	42	59	48	42	58	48	42	35
0.80	70	59	52	69	58	51	67	57	51	44
1.00	78	67	60	77	67	60	74	68	60	53
1.25	85	75	68	83	74	68	81	73	67	60
1.50	90	80	74	88	79	73	85	78	72	65
2.00	96	88	82	94	87	81	91	85	80	72
2.50	100	93	87	98	91	86	94	88	84	76
3.00	103	97	91	101	95	90	97	92	88	79
4.00	107	101	97	104	100	96	100	96	93	84
5.00	109	105	101	107	103	99	102	99	96	86
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNM = 1.25			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

ISOCANDELA DIAGRAM

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

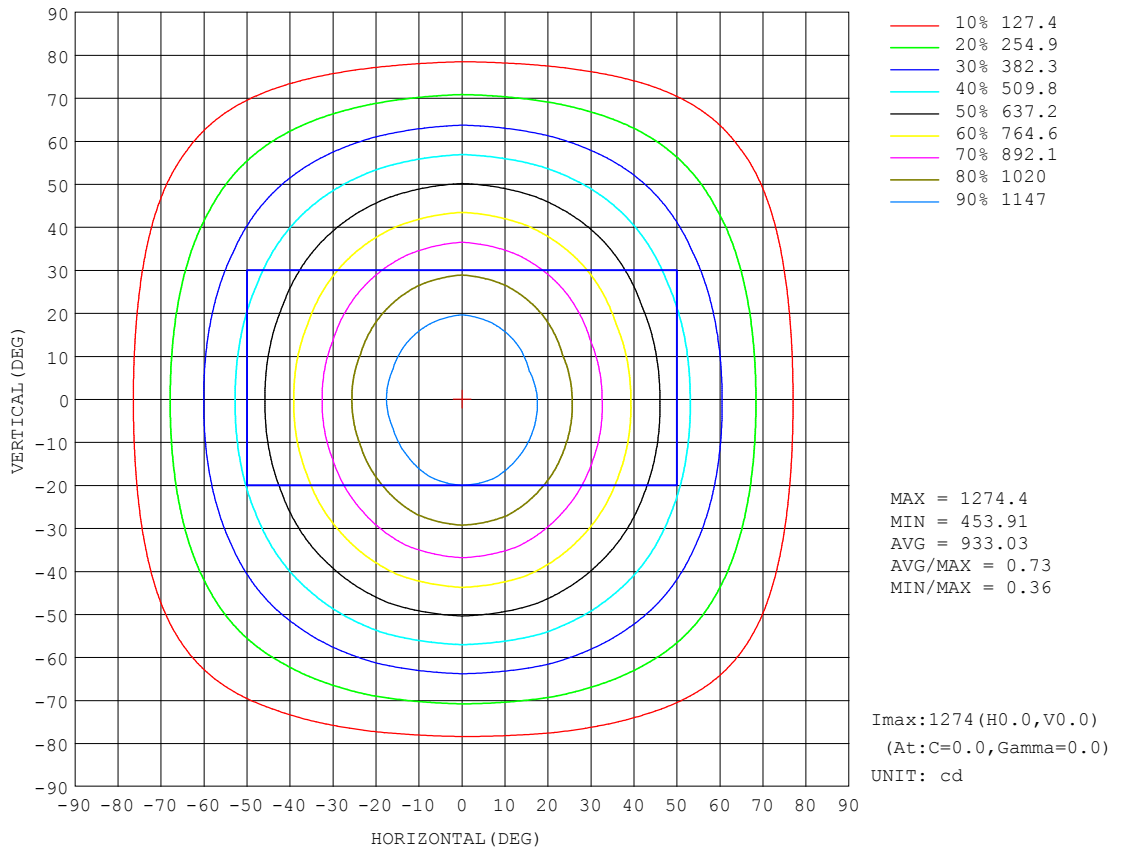

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

AAI Figure

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME:ILLCLBV	TYPE:ILLCLBV	WEIGHT:
SPEC.:4FT	DIM.: 4FT	SERIAL No.:1
MFR.: i-Luminosty	SUR.:1220*50	Shielding Angle:

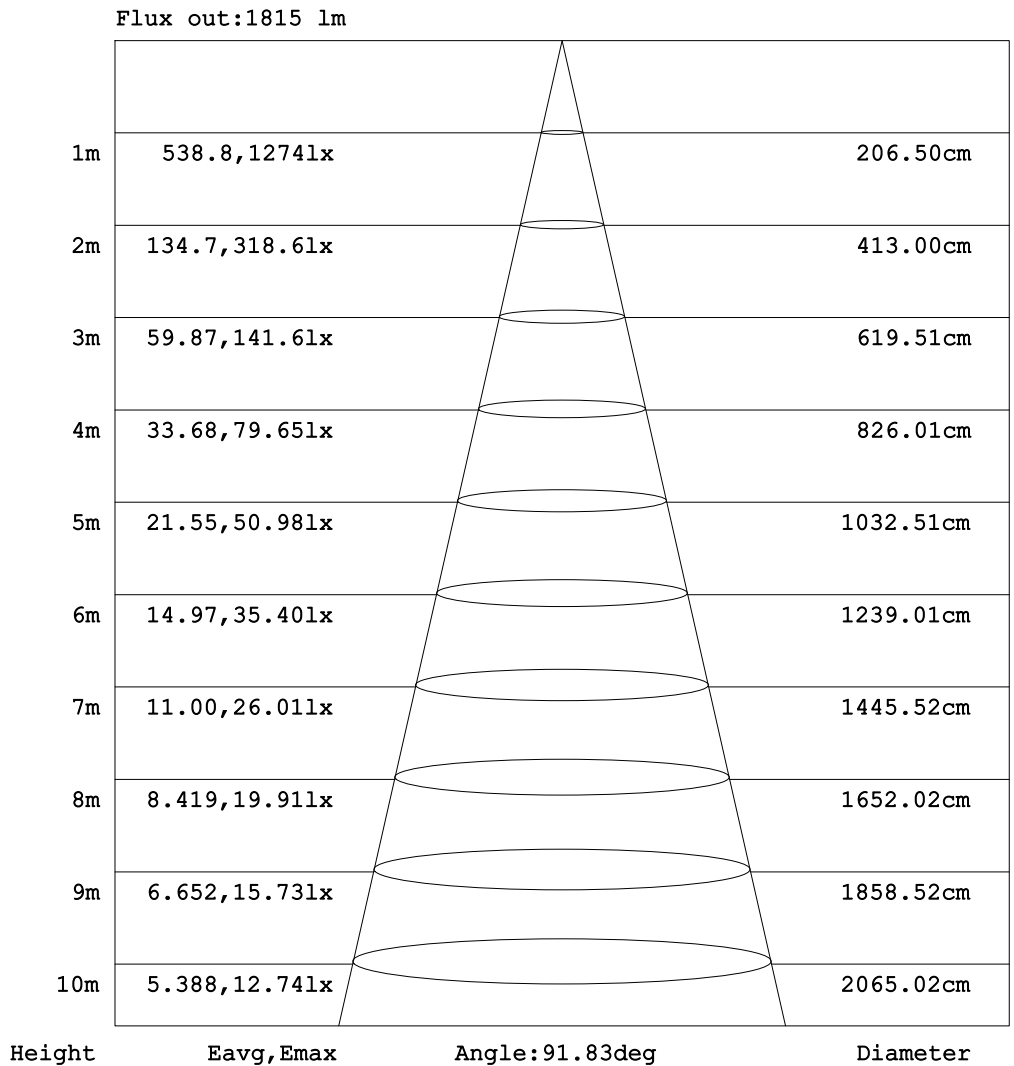

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:KEVINLI
 Test Date:2017-12-23


γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

ISOLUX DIAGRAM

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: i-Luminosity	SUR.: 1220*50	Shielding Angle:

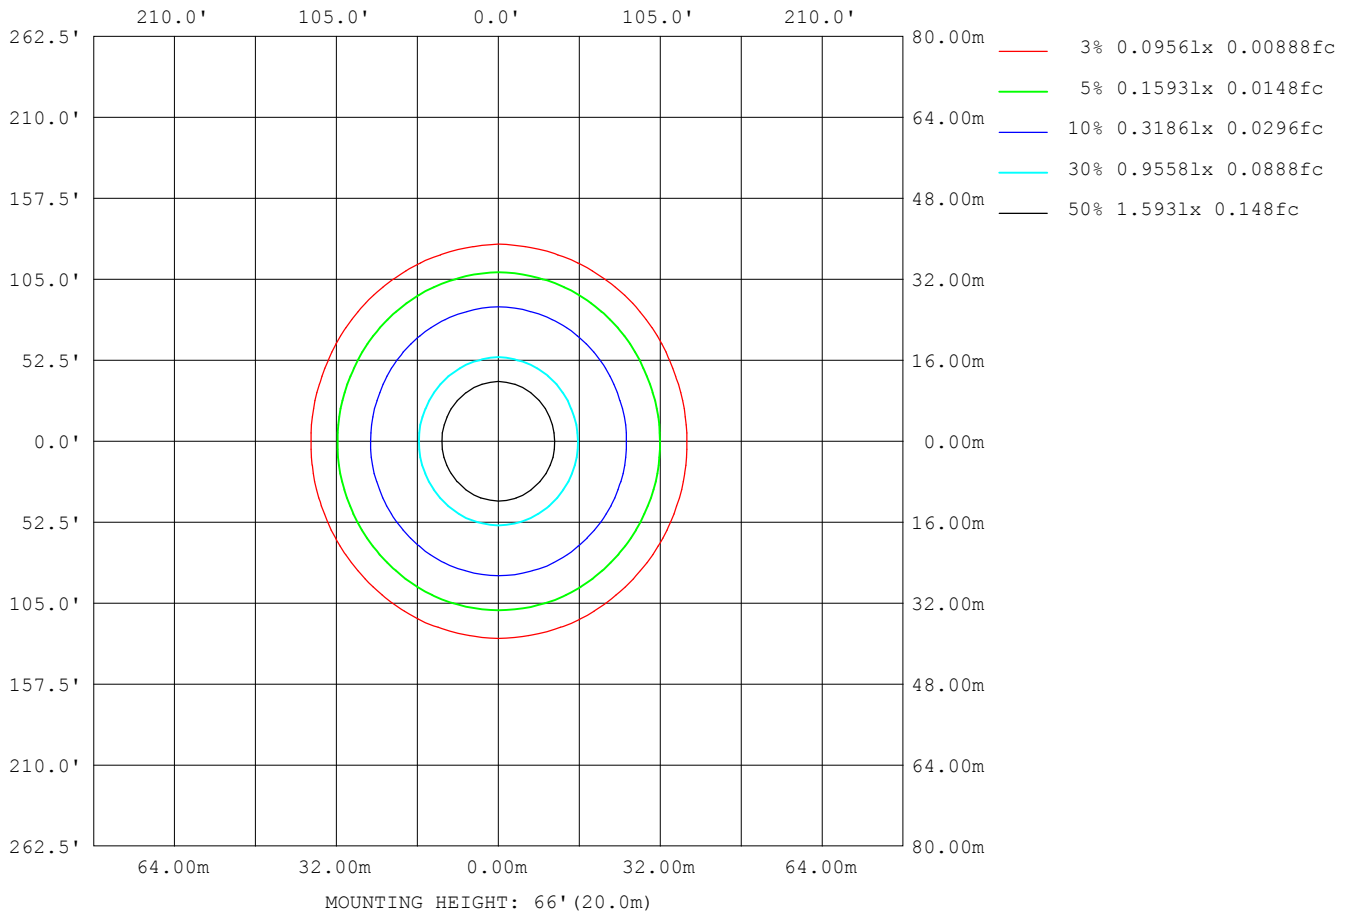

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

LED Avg.L Report

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE:ILLCLBV	WEIGHT:
SPEC.:4FT	DIM.: 4FT	SERIAL No.:1
MFR.: i-Luminosity	SUR.:1220*50	Shielding Angle:

AvgL	cd/m2
L_0~180 (65) av	11751
L_0~180 (75) av	9532
L_0~180 (85) av	5925
L_90~270 (65) av	13962
L_90~270 (75) av	11598
L_90~270 (85) av	7722
L_45 (65) av	12722
L_45 (75) av	10403
L_45 (85) av	6647

Standard: GB/T 29293-2012


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:KEVINLI
 Test Date:2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

Planar Illuminance Curve

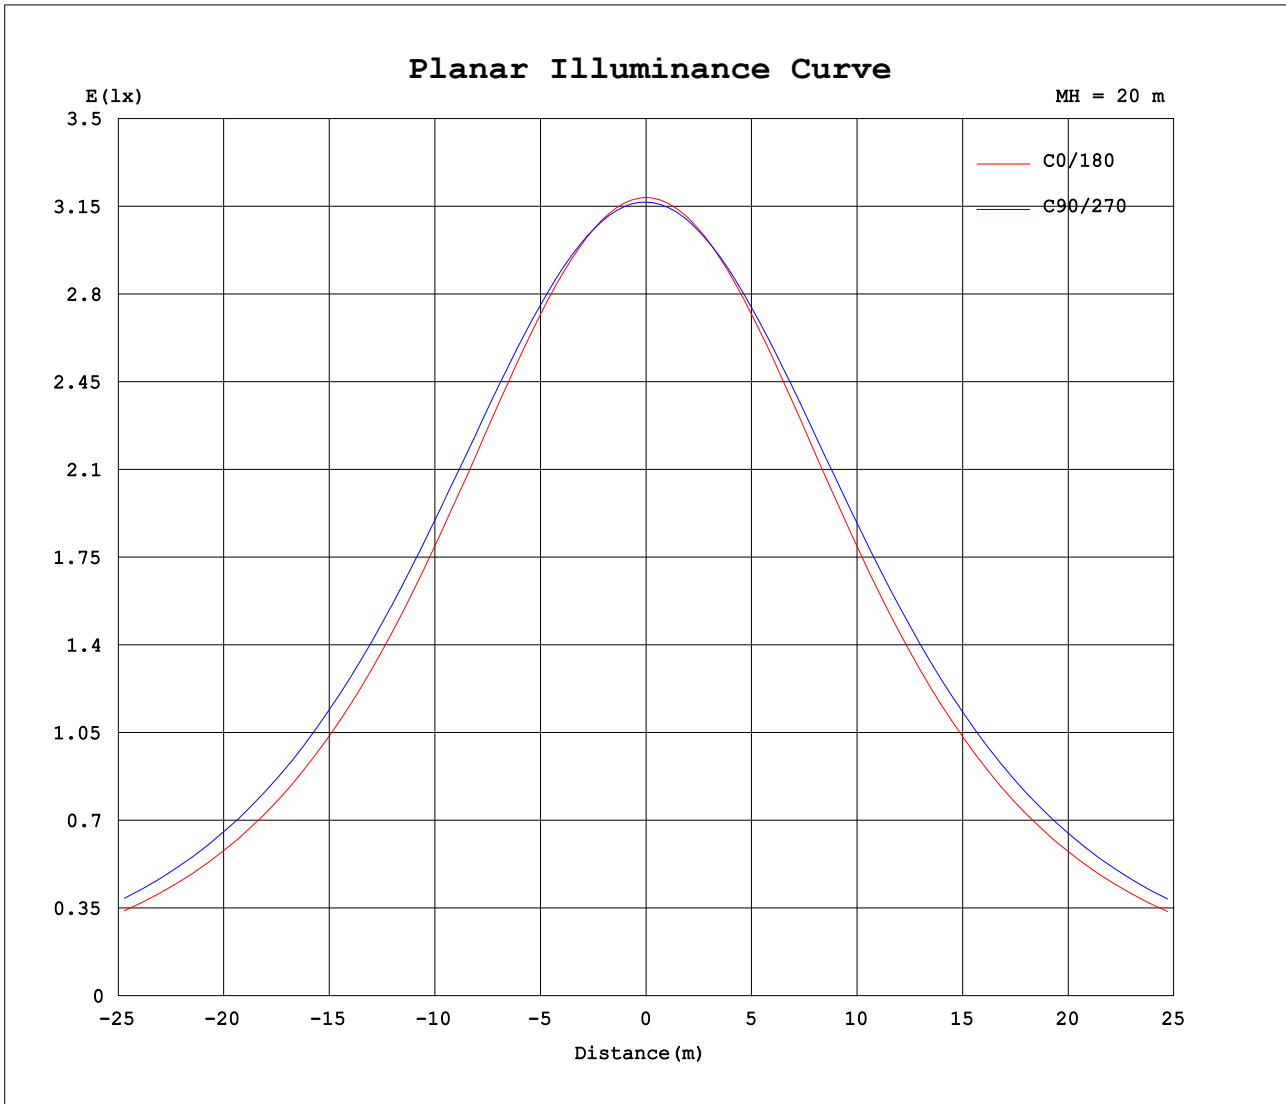

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:



Date:	_____
Project:	_____
Price:	_____

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:219.88V I:0.1433A P:30.375W PF:0.9639 Freq:49.99Hz Lamp Flux:3058.97x1 lm		
NAME: ILLCLBV	TYPE: ILLCLBV	WEIGHT:
SPEC.: 4FT	DIM.: 4FT	SERIAL No.: 1
MFR.: ILLCLBV	SUR.: 1220*50	Shielding Angle:

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268	1268			
5	1257	1259	1259	1261	1261	1260	1259	1258	1257	1256	1257	1258	1259	1259	1258	1256			
10	1225	1229	1232	1237	1238	1236	1232	1229	1226	1225	1229	1232	1235	1233	1230	1225			
15	1174	1181	1189	1198	1201	1197	1187	1180	1175	1175	1184	1191	1196	1192	1186	1175			
20	1106	1116	1129	1145	1149	1143	1127	1115	1106	1108	1123	1135	1143	1137	1125	1109			
25	1025	1038	1057	1078	1084	1076	1054	1037	1025	1028	1049	1067	1078	1069	1052	1031			
30	936	950	974	1001	1009	999	971	948	935	940	965	988	1002	992	969	943			
35	842	857	884	916	926	913	880	855	840	846	874	902	919	906	880	850			
40	747	762	790	825	836	822	786	759	744	750	780	811	829	815	787	755			
45	653	668	696	731	742	727	691	664	649	655	685	717	736	721	692	661			
50	562	576	601	635	646	632	596	570	557	563	591	622	640	627	599	569			
55	474	486	509	540	550	536	503	480	468	473	499	527	545	533	508	481			
60	389	400	419	447	454	442	413	392	381	386	410	434	451	440	418	394			
65	307	316	332	355	361	350	325	308	299	302	323	344	359	349	332	311			
70	228	236	248	266	270	261	240	228	220	223	239	256	269	261	248	231			
75	154	160	168	181	183	176	160	152	146	148	160	172	183	178	169	156			
80	88.0	91.9	95.9	103	104	99.1	89.0	84.7	80.8	81.0	88.7	96.2	104	101	96.4	88.6			
85	34.4	36.6	38.1	41.3	40.9	38.0	32.6	30.9	28.6	28.3	32.4	35.9	41.2	39.6	38.3	34.2			
90	3.02	3.12	3.13	3.29	3.22	3.10	2.99	2.86	2.59	2.65	2.75	2.89	3.08	2.98	2.94	2.68			
95	3.09	3.11	3.18	3.39	3.49	3.47	3.31	3.19	2.85	2.89	3.06	3.18	3.26	3.12	2.94	2.79			
100	3.47	3.48	3.58	3.82	3.95	3.90	3.72	3.57	3.16	3.24	3.42	3.59	3.68	3.50	3.29	3.12			
105	3.92	3.91	4.02	4.28	4.44	4.38	4.19	4.01	3.53	3.59	3.83	4.03	4.16	3.96	3.69	3.50			
110	4.40	4.40	4.51	4.78	4.97	4.89	4.68	4.51	3.95	4.03	4.30	4.51	4.66	4.41	4.13	3.90			
115	4.95	4.93	5.03	5.28	5.51	5.41	5.22	5.06	4.41	4.51	4.78	5.00	5.16	4.88	4.59	4.36			
120	5.53	5.50	5.60	5.83	6.09	5.96	5.80	5.64	4.91	5.02	5.29	5.50	5.68	5.36	5.08	4.86			
125	6.17	6.12	6.19	6.40	6.67	6.55	6.42	6.28	5.46	5.57	5.83	6.01	6.20	5.86	5.60	5.39			
130	6.84	6.79	6.81	7.00	7.28	7.14	7.05	6.94	6.05	6.16	6.40	6.55	6.75	6.40	6.16	5.98			
135	7.50	7.44	7.46	7.60	7.88	7.76	7.66	7.59	6.68	6.79	7.00	7.11	7.31	6.97	6.76	6.61			
140	8.14	8.10	8.06	8.17	8.43	8.36	8.26	8.21	7.33	7.41	7.60	7.71	7.87	7.54	7.36	7.26			
145	8.75	8.74	8.64	8.72	8.96	8.93	8.81	8.81	7.99	8.06	8.20	8.32	8.44	8.11	7.97	7.95			
150	9.34	9.36	9.19	9.23	9.45	9.47	9.35	9.37	8.67	8.69	8.82	8.91	9.02	8.69	8.59	8.61			
155	9.93	9.95	9.73	9.75	9.97	9.99	9.90	9.89	9.32	9.29	9.42	9.50	9.56	9.27	9.18	9.25			
160	10.5	10.5	10.3	10.2	10.4	10.5	10.4	10.4	9.99	9.90	10.0	10.1	10.1	9.81	9.76	9.89			
165	11.0	11.0	10.7	10.7	10.9	10.9	10.8	10.9	10.7	10.5	10.5	10.6	10.6	10.3	10.3	10.5			
170	11.5	11.4	11.1	11.1	11.2	11.3	11.2	11.3	11.3	11.0	11.0	11.0	11.0	10.8	10.8	11.0			
175	11.9	11.7	11.5	11.4	11.4	11.5	11.5	11.6	11.7	11.5	11.4	11.4	11.3	11.2	11.3	11.4			
180	12.0	11.8	11.6	11.5	11.5	11.5	11.5	11.6	12.0	11.7	11.6	11.5	11.5	11.5	11.6	11.6			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: KEVINLI
 Test Date: 2017-12-23

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 7.310m [K=1.0000]
 Remarks:

